


FOR CU PIPING 4" CLEAR GAP  
REQUIRED IN BETWEEN BEAM  
AND FALSE CEILING

30 HP(18 HP+ 12HP) VRV ODU  
1657H X 1240W X 765D  
to be placed on Ground floor

2.64 TR Cassette Unit  
FXFSQ80,2 Nos  
Unit - 256H X 840W X 840D  
Panel - 50H X 950W X 950D

18 HP  
12 HP

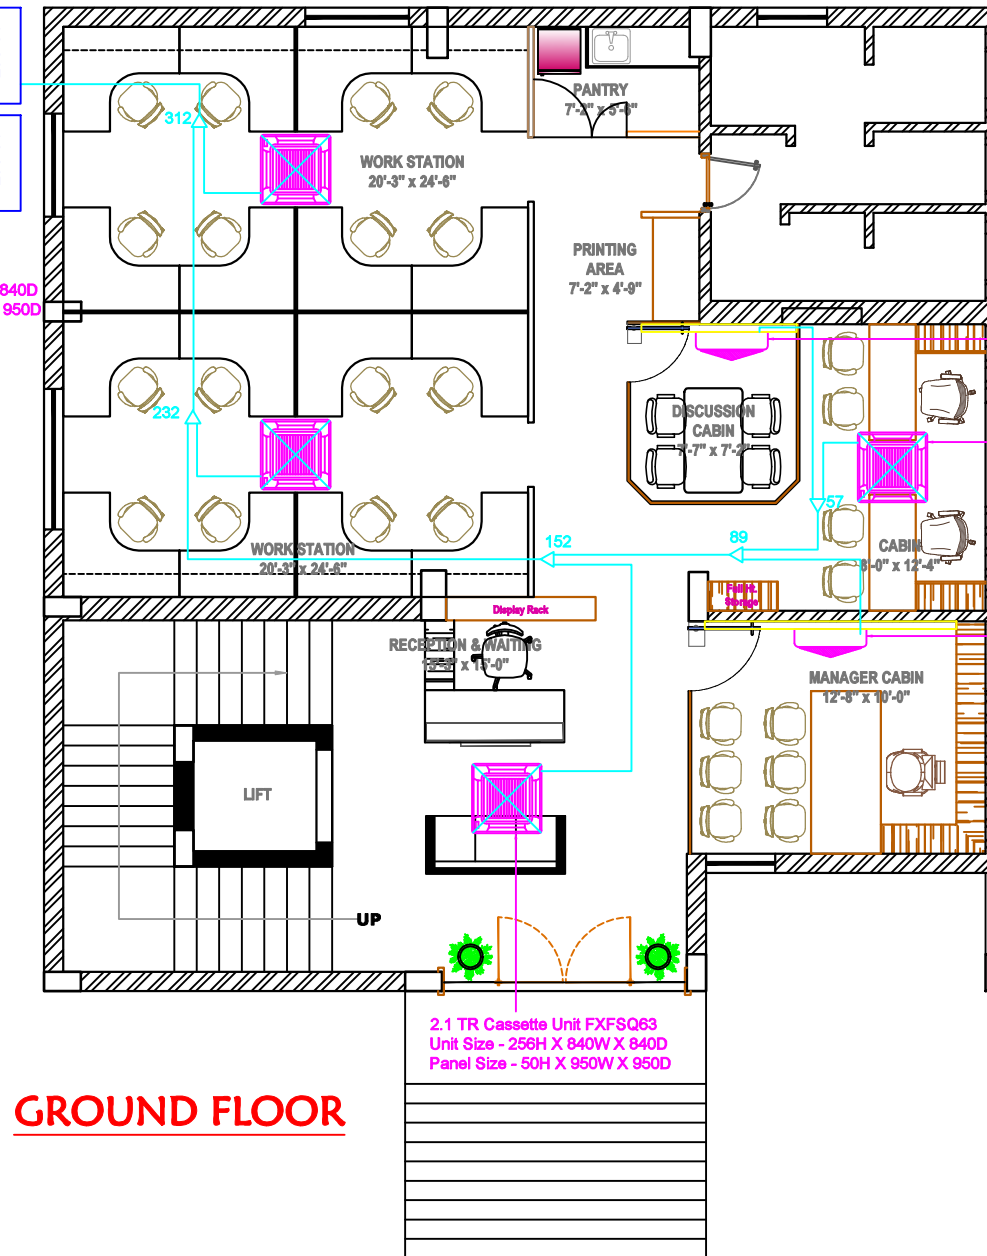

**GROUND FLOOR**

0.8 TR - Highwall Unit  
FXAQ25  
298H X 929W X 258D

1.0 TR Cassette Unit FXFSQ32  
Unit Size - 256H X 840W X 840D  
Panel Size - 50H X 950W X 950D

1.0 TR - Highwall Unit  
FXAQ32  
298H X 929W X 258D

HVAC ASSOCIATE

*Kulng Services*

SHOP NO 1 & 2, ONKAR COMPLEX,  
TARABAI PARK, KOLHAPUR.  
PH. NO. - +91 9325753999,  
+91 9820401120.  
Fax - +91 231 2656339.  
EMAIL: atulngawale@yahoo.co.in

**TITLE:-** HVAC DETAILS OF OFFICE .

**PROJECT:-** PROPOSED INTERIOR WORK FOR KARNATAKA STATE SOUHARDA FEDERAL CO-OP LIMITED. AT-KALABURGI.



|         |               |         |       |
|---------|---------------|---------|-------|
| JOB NO. |               | DEALT   | Pavan |
| DATE    | 21 APRIL 2022 | CHECK   | KIRAN |
| SCALE   | N.T.S.        | DWG.NO. |       |

**SPACE**  
**DESIGNER'S**  
INTERIOR DESIGNERS

Shop No.1,Shubhashri Apartment  
Near Shri Shahu Putala  
Ichalkaranji 416115  
Mo: 097657 29111  
092721 21117  
Mail:idspacedesigners@gmail.com