


FOR CU PIPING 4" CLEAR GAP  
REQUIRED IN BETWEEN BEAM  
AND FALSE CEILING

2.1 TR Cassette Unit  
FXFSQ63,4 Nos  
Unit - 256H X 840W X 840D  
Panel - 50H X 950W X 950D

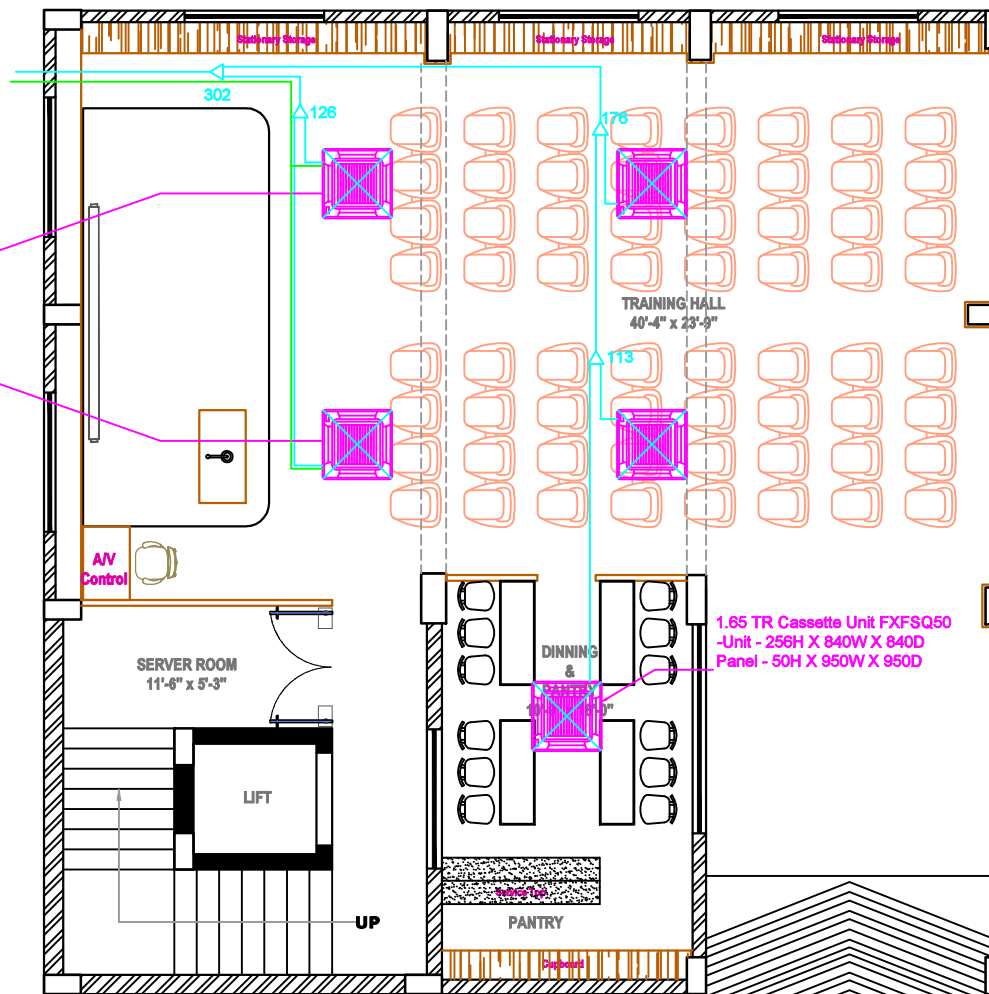

1.65 TR Cassette Unit FXFSQ50  
-Unit - 256H X 840W X 840D  
Panel - 50H X 950W X 950D

**BASEMENT FLOOR**

HVAC ASSOCIATE  
*Kuling Services*  
SHOP NO 1 & 2, ONKAR COMPLEX,  
TARABAI PARK, KOLHAPUR.  
PH. NO. - +91 9325753999,  
+91 9822401120.  
Fax - +91 231 2656339.  
EMAIL: atulingawale@yahoo.co.in

TITLE:- HVAC DETAILS OF OFFICE .

PROJECT:- PROPOSED INTERIOR WORK FOR KARNATAKA STATE SOUHARDA FEDERAL CO-OP LIMITED. AT-KALABURGI.



JOB NO.		DEALT	Pavan
DATE	21 APRIL 2022	CHECK	KIRAN
SCALE	N.T.S.	DWG.NO.	

**SPACE**  
**DESIGNER'S**  
INTERIOR DESIGNERS

Shop No.1,Shubhashri Apartment  
Near Shri Shahu Putala  
Ichalkaranji 416115  
Mo: 097657 29111  
092721 21117  
Mail:idspacedesigners@gmail.com